



Intertek
5011097

CONFORMS TO
NSF/ANSI STD. 20



Intertek
5011097

CONFORMS TO
UL STD. No.471
CERTIFIED TO
CSA STD. C22.2
No.120



Intertek
EP5021730


ENERGY
PERFORMANCE
VERIFIED

RENDEMENT
ENERGETIQUE
VERIFIE

- Fits 3, 5, and 6-gallon milk bags
- 8ft, 3-prong cord
- NEMA 5-15P plug
- Single Phase
- 115V/60Hz/1.2A

#72907

2-Valve

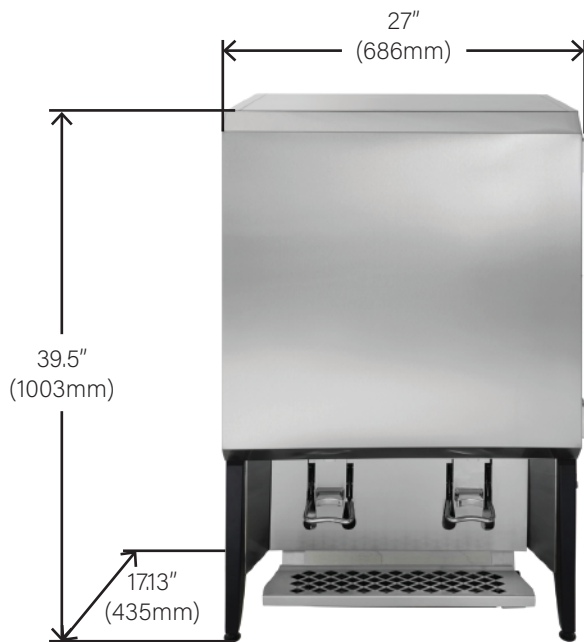


107.59lbs/48.8kg without packaging

27inW x 17.13inD x 39.5inH

#92900

3-Valve

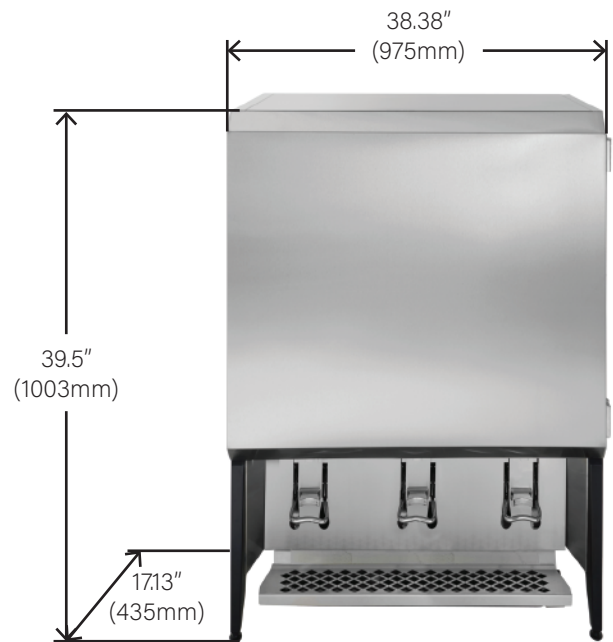

140.43lbs/63.7kg without packaging

38.38inW x 17.13inD x 39.5inH

WARRANTY: Hubert warrants this equipment from failures in material and workmanship for one(1) year from date of purchase with proof of purchase, provided the equipment is operated and maintained in conformity with the provided Instruction Manual. Any failed part of the equipment will be repaired or replaced without charge at Hubert's discretion.